




Air Quality Acceptable Criteria : 2100 ug/m³
Unit : ug/m³

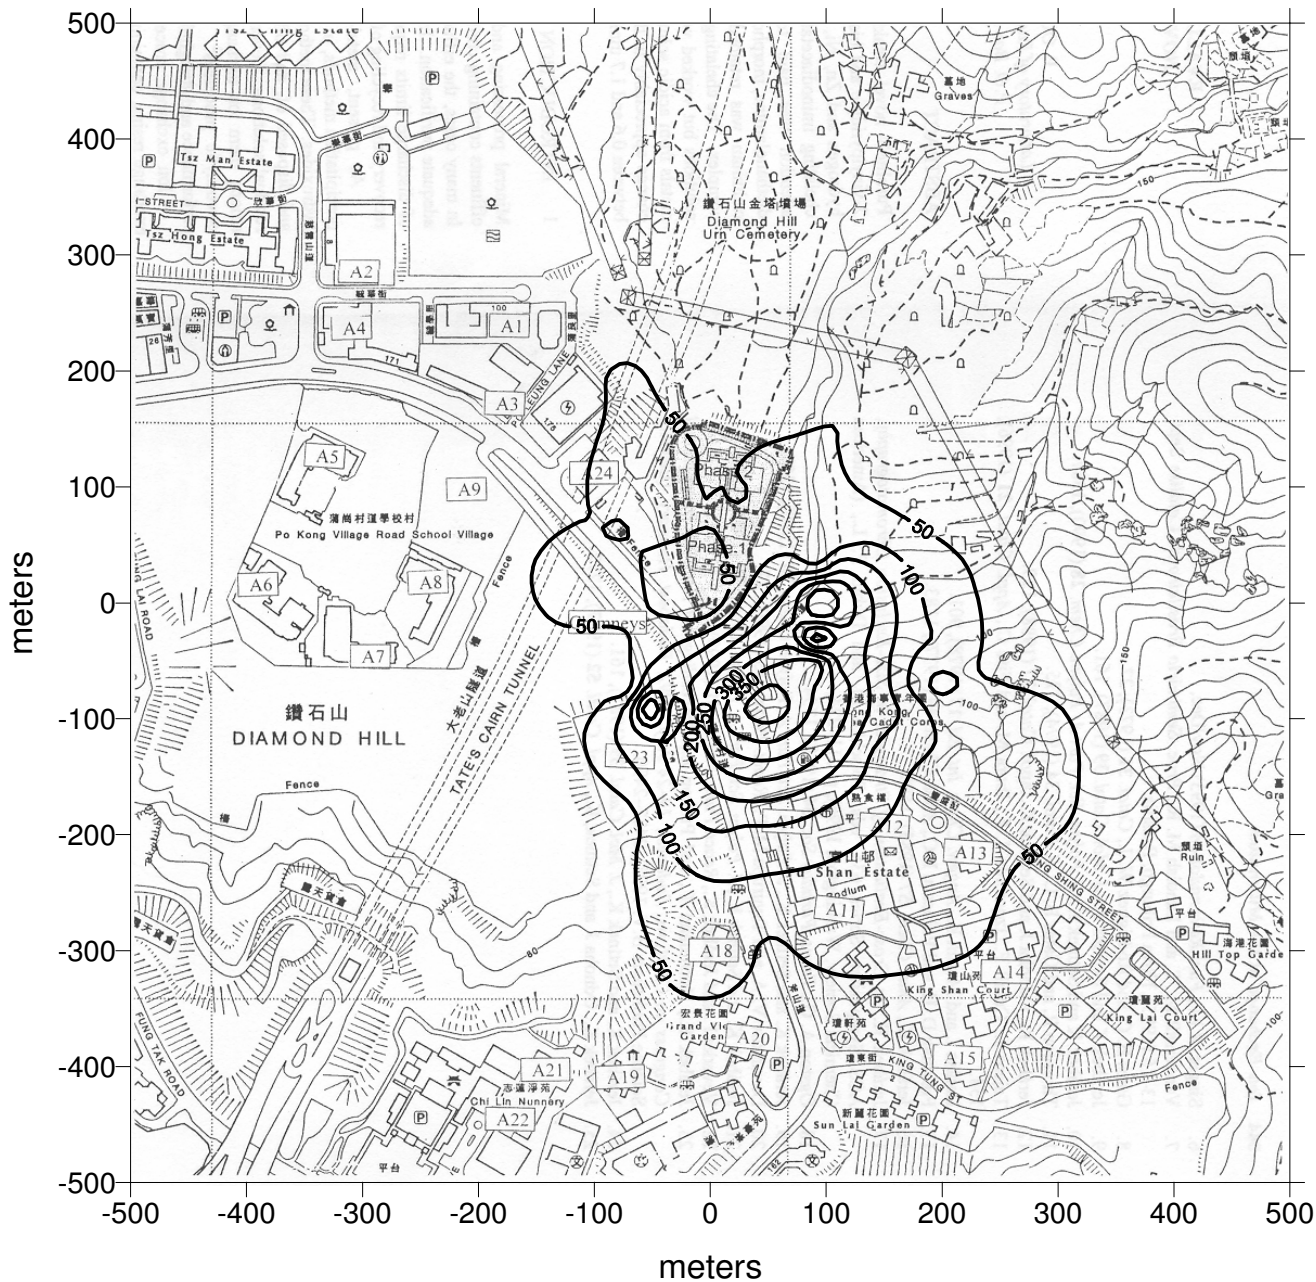

**Hong Kong
Productivity Council**
香港生產力促進局

Project Title : Reprovisioning of Diamond Hill Crematorium EIA

Figure 4.25 : Maximum level of HCl During Operation at 61.5 mA.G.
(worst hit level, 1-hour average)