




--- Air Quality Acceptable Criteria : 5 OU
Unit : Odour Unit, OU

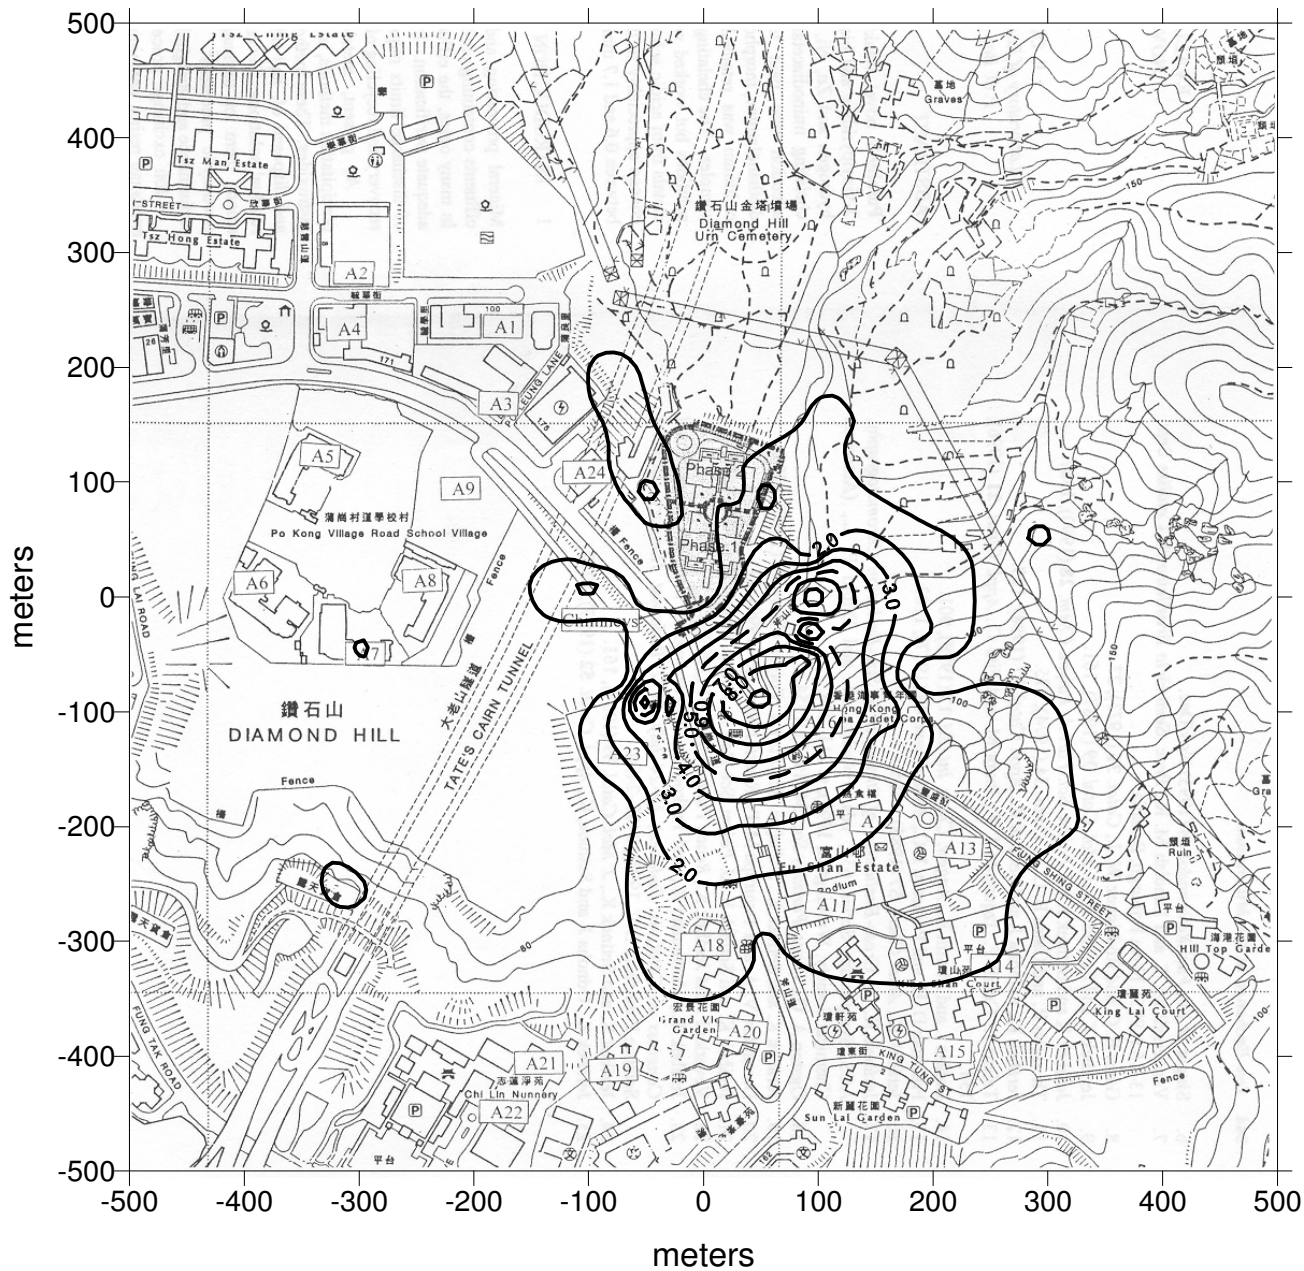

**Hong Kong
Productivity Council**
香港生產力促進局

Project Title : Reprovisioning of Diamond Hill Crematorium EIA

Figure 4.30 : Maximum level of Odour (5-second average) During Operation at 61.5 mA.G. (under Stability Class E,F)