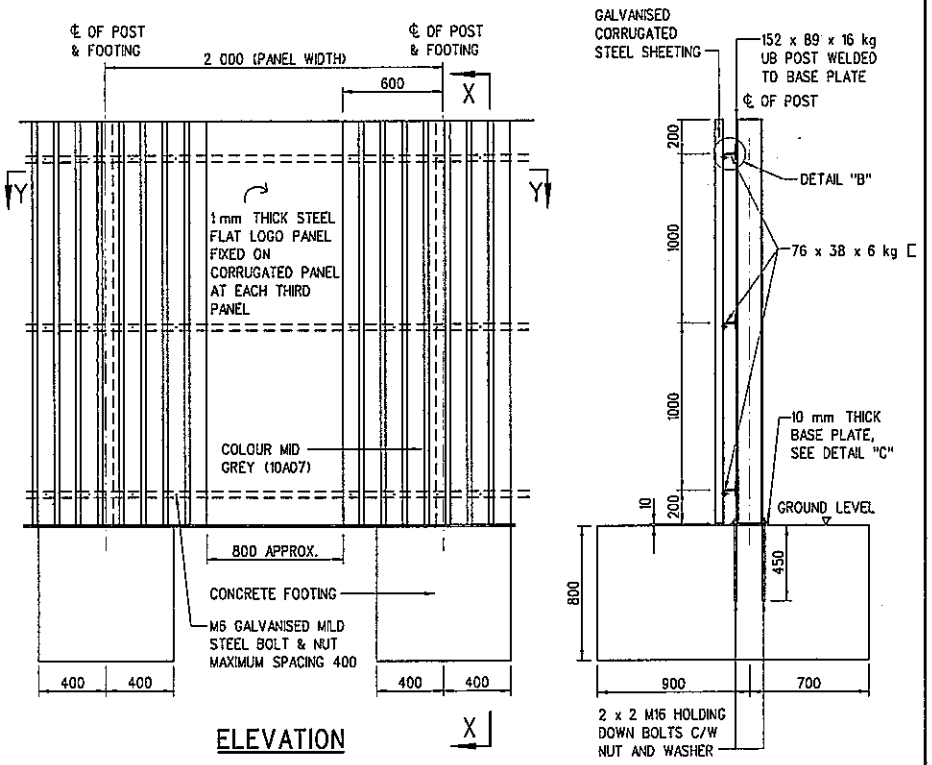

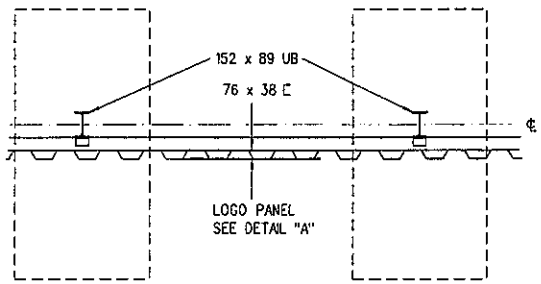

SECTION Y-Y

NOTES :
1. FOR NOTES, SEE SHEET 2.

REV.	DESCRIPTION	SIGNATURE	DATE
B	HEIGHT OF STEEL SHEETING AND SIZES OF POST & FOOTING REVISED	ORIGINAL SIGNED	8.2.2002
A	GENERAL REVIEW	ORIGINAL SIGNED	2.2.2001

SITE HOARDING

DRAINAGE SERVICES DEPARTMENT

REFERENCE

SCALE 1 : 30

DRAWING No. DS 1065B (SHEET 1 OF 2)

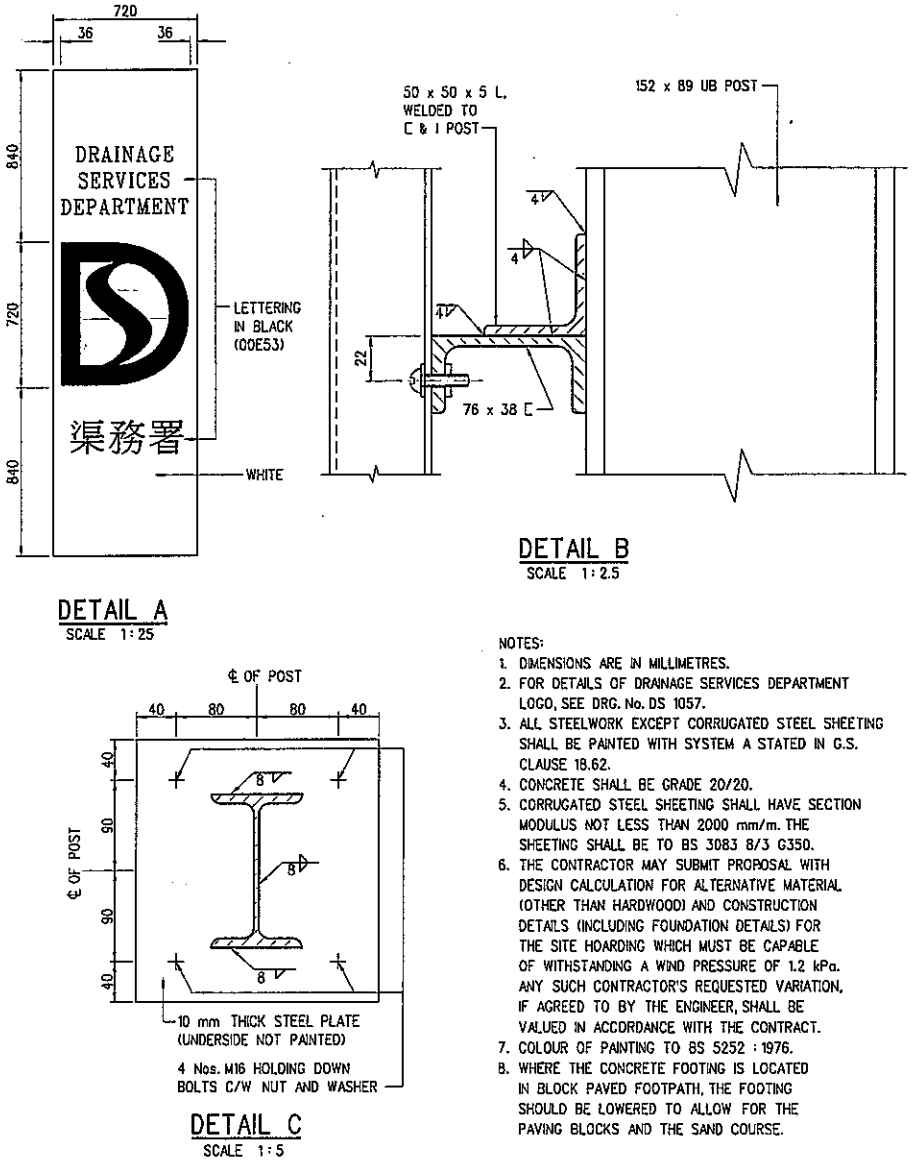

NOTES:
1. DIMENSIONS ARE IN MILLIMETRES.
2. FOR DETAILS OF DRAINAGE SERVICES DEPARTMENT LOGO, SEE DRG. No. DS 1057.
3. ALL STEELWORK EXCEPT CORRUGATED STEEL SHEETING SHALL BE PAINTED WITH SYSTEM A STATED IN G.S. CLAUSE 18.62.
4. CONCRETE SHALL BE GRADE 20/20.
5. CORRUGATED STEEL SHEETING SHALL HAVE SECTION MODULUS NOT LESS THAN 2000 mm/m. THE SHEETING SHALL BE TO BS 3083 8/3 G350.
6. THE CONTRACTOR MAY SUBMIT PROPOSAL WITH DESIGN CALCULATION FOR ALTERNATIVE MATERIAL (OTHER THAN HARDWOOD) AND CONSTRUCTION DETAILS (INCLUDING FOUNDATION DETAILS) FOR THE SITE HOARDING WHICH MUST BE CAPABLE OF WITHSTANDING A WIND PRESSURE OF 1.2 kPa. ANY SUCH CONTRACTOR'S REQUESTED VARIATION, IF AGREED TO BY THE ENGINEER, SHALL BE VALUED IN ACCORDANCE WITH THE CONTRACT.
7. COLOUR OF PAINTING TO BS 5252 : 1976.
8. WHERE THE CONCRETE FOOTING IS LOCATED IN BLOCK PAVED FOOTPATH, THE FOOTING SHOULD BE LOWERED TO ALLOW FOR THE PAVING BLOCKS AND THE SAND COURSE.

REV.	DESCRIPTION	SIGNATURE	DATE
B	HEIGHT OF STEEL SHEETING AND SIZES OF POST & FOOTING REVISED	ORIGINAL SIGNED	8.2.2002
A	GENERAL REVIEW	ORIGINAL SIGNED	2.2.2001

SITE HOARDING

DRAINAGE SERVICES DEPARTMENT

REFERENCE

SCALE AS SHOWN

DRAWING No. DS 1065B (SHEET 2 OF 2)

Figure 9.18 DSD Standard Site Hoarding